


UT1102KA Kaw WTP Intake

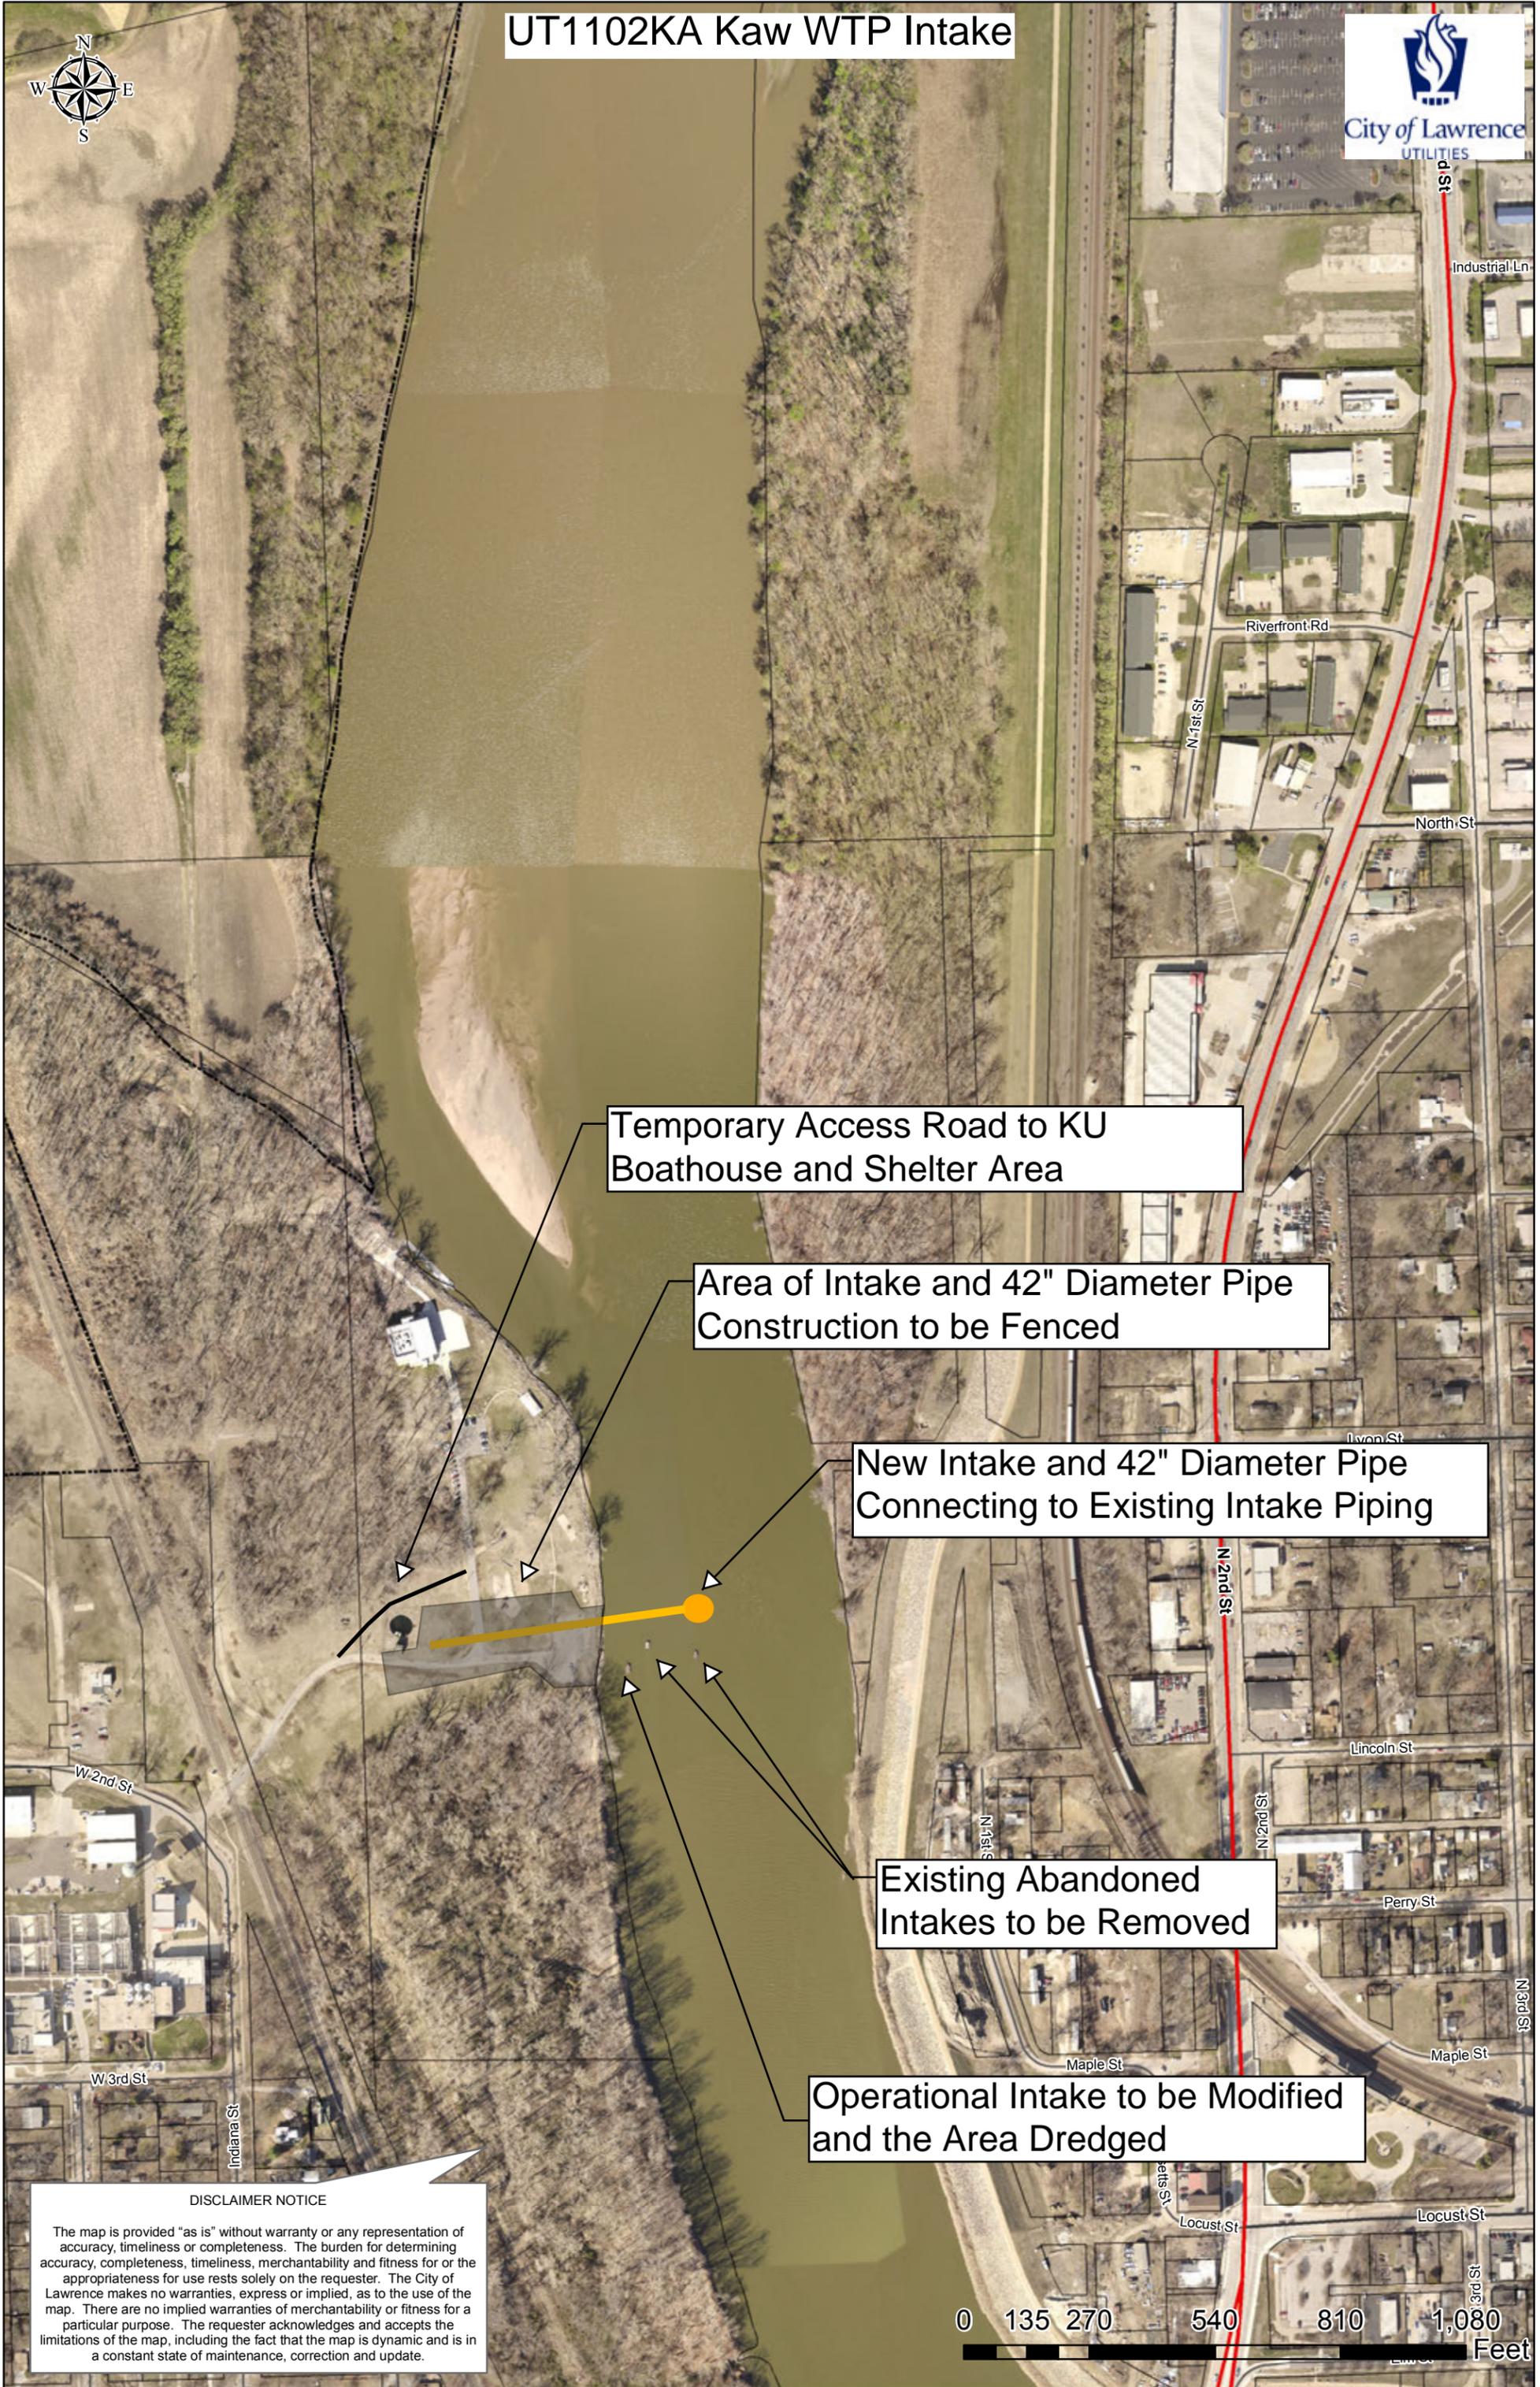

Temporary Access Road to KU Boathouse and Shelter Area

Area of Intake and 42" Diameter Pipe Construction to be Fenced

New Intake and 42" Diameter Pipe Connecting to Existing Intake Piping

Existing Abandoned Intakes to be Removed

Operational Intake to be Modified and the Area Dredged

DISCLAIMER NOTICE
The map is provided "as is" without warranty or any representation of accuracy, timeliness or completeness. The burden for determining accuracy, completeness, timeliness, merchantability and fitness for or the appropriateness for use rests solely on the requester. The City of Lawrence makes no warranties, express or implied, as to the use of the map. There are no implied warranties of merchantability or fitness for a particular purpose. The requester acknowledges and accepts the limitations of the map, including the fact that the map is dynamic and is in a constant state of maintenance, correction and update.

