


# UT1419 8th Street Watermain Replacement



4 each Inoperable 14" Diameter Valves to be Replaced

1400 feet of 1900's 14" Watermain to be Replaced

1 each Inoperable 20" Diameter Valves to be Removed

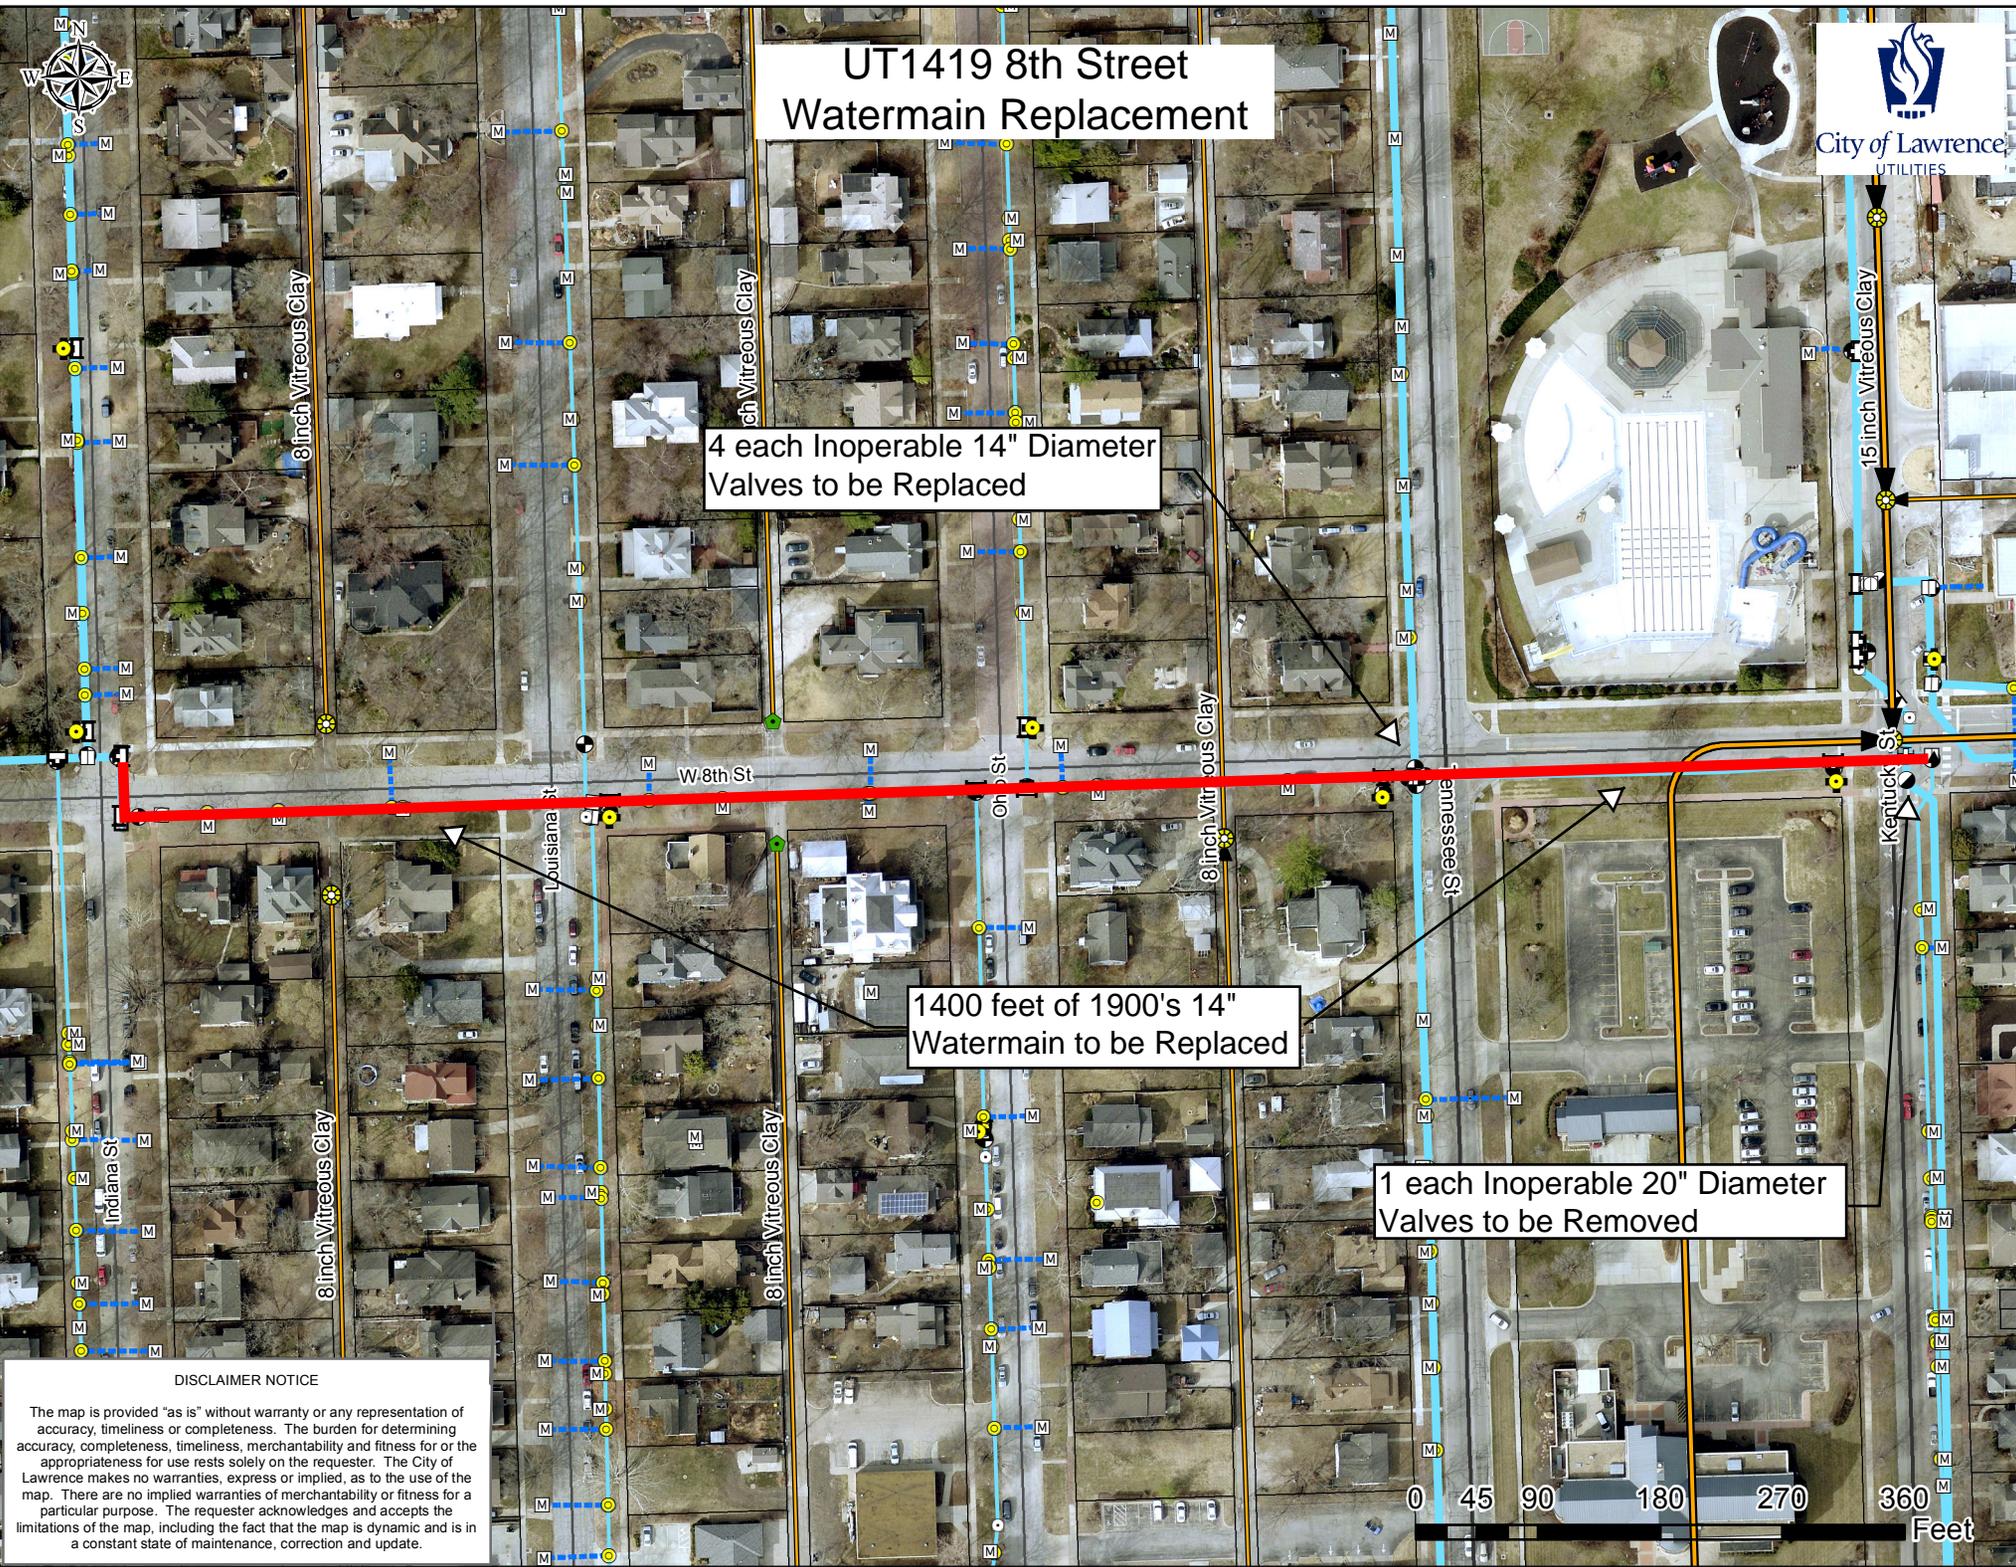

**DISCLAIMER NOTICE**  
The map is provided "as is" without warranty or any representation of accuracy, timeliness or completeness. The burden for determining accuracy, completeness, timeliness, merchantability and fitness for or the appropriateness for use rests solely on the requester. The City of Lawrence makes no warranties, express or implied, as to the use of the map. There are no implied warranties of merchantability or fitness for a particular purpose. The requester acknowledges and accepts the limitations of the map, including the fact that the map is dynamic and is in a constant state of maintenance, correction and update.

